

TOWN OF GULF STREAM, FLORIDA
Invitation to Bid, ITB No. 20-001



TOWN OF GULF STREAM
PALM BEACH COUNTY, FLORIDA

Invitation to Bid No. 20-001


The Town of Gulf Stream will receive sealed bids in response to this Invitation to Bid at the Office of Rita Taylor, Town Clerk, Town Hall, 100 Sea Road, Gulf Stream, Florida 33483, (561) 276-5116, for furnishing the following:

Installation of a double detector check valve assembly and removal of an existing weighted check valve from inside a concrete underground vault and replacement with a double flange spool piece of the same length. The work will be located just north of the Place Au Soleil entrance, located at the intersection of North Federal Highway and Avenue Au Soleil, in Gulf Stream. For additional details, see Exhibit A – Double Detector Check Valve diagram; and Exhibit B – Survey of Property

Responses to this ITB must be clearly marked “**ITB No. 20-001, Double Detector Check Valve**” and must be received by the Town Clerk at 100 Sea Road, Gulf Stream, Florida 33483, either by mail or hand delivery, no later than **2:00 p.m. local time on Friday, November 6, 2020**. Bids must be sealed. It is anticipated that the bids shall be opened at 2:00 p.m. at Town Hall, located at 100 Sea Road, Gulf Stream, Florida 33483, on the same date. Any bids delivered or received after 2:00 p.m. local time on said date will not be accepted under any circumstances. Any uncertainty regarding the time a bid is delivered or received will be resolved against the Bidder.

The Town reserves the right to reject any or all bids, to waive any informalities or irregularities in any bids received, to re-advertise for bids, or take any other such actions that may be deemed to be in the best interest of the Town.

Respondents to this solicitation or persons acting on their behalf may not contact, between the release of the solicitation and the end of the 72-hour period following the agency posting the notice of intended award, excluding Saturdays, Sundays, and state holidays, any employee or officer of the executive or legislative branch concerning any aspect of this solicitation, except in writing to the procurement officer or as provided in the solicitation documents. Violation of this provision may be grounds for rejecting a response.

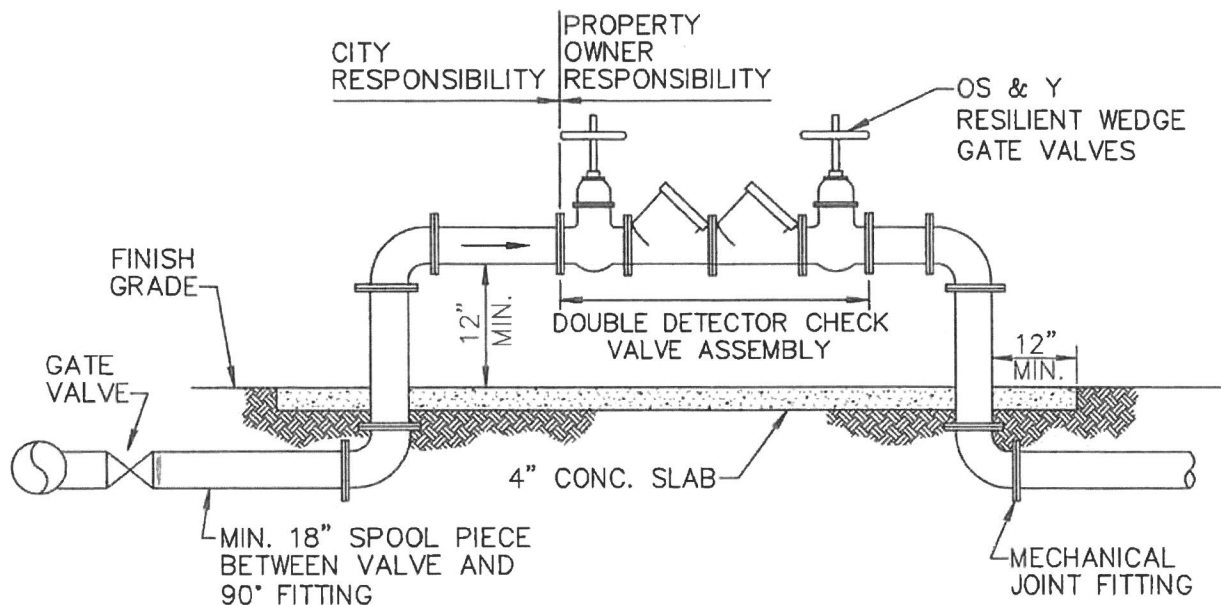

NOTES:

1. FOR ALL SERVICES GREATER THAN 2" DIA.
2. ALL PIPE AND FITTINGS SHALL BE CLASS 52 DUCTILE IRON CEMENT LINED WITH CEMENT LINED DUCTILE IRON FLANGE FITTINGS FOR ABOVE GROUND USE. MECHANICAL JOINT SHALL BE USED UNDERGROUND IN ACCORDANCE WITH AWWA STANDARDS.
3. THE DOUBLE DETECTOR CHECK VALVE ASSEMBLY SHALL MEET AWWA C511-89, AND APPROVAL OF ENVIRONMENTAL SERVICES DEPARTMENT.
4. CERTIFICATION OF PROPER INSTALLATION AND OPERATION WILL BE REQUIRED FROM A CERTIFIED BACKFLOW PREVENTION TECHNICIAN PRIOR TO WATER MAIN ACCEPTANCE BY THE CITY OF DELRAY BEACH.
5. THE PROPERTY OWNER SHALL BE RESPONSIBLE FOR THE PROPER OPERATION, MAINTENANCE AND TESTING OF THE DOUBLE DETECTOR CHECK VALVE ASSEMBLY.
6. BOLLARDS TO BE USED IF THE ASSEMBLY IS WITHIN 5' OF THE PAVEMENT, REFER TO BOLLARD DETAIL PW 5.2.
7. ALL TWO INCH DOUBLE DETECTOR CHECK VALVE, SHALL BE BRASS OR TYPE "L" COPPER TUBING
8. USE OF OTHER PIPE MATERAILS WITH APPROVAL OF WATER SEWER MANAGER.
9. CITY MAINTAINS UP TO THE FIRST O S & Y VALVE.



CITY of DELRAY BEACH
 ENVIRONMENTAL SERVICES DEPARTMENT
 434 SOUTH SWINTON AVENUE, DELRAY BEACH, FLORIDA 33444

DOUBLE DETECTOR CHECK VALVE

DATE: 06-27-2014

PW 10.1

Ex. A

